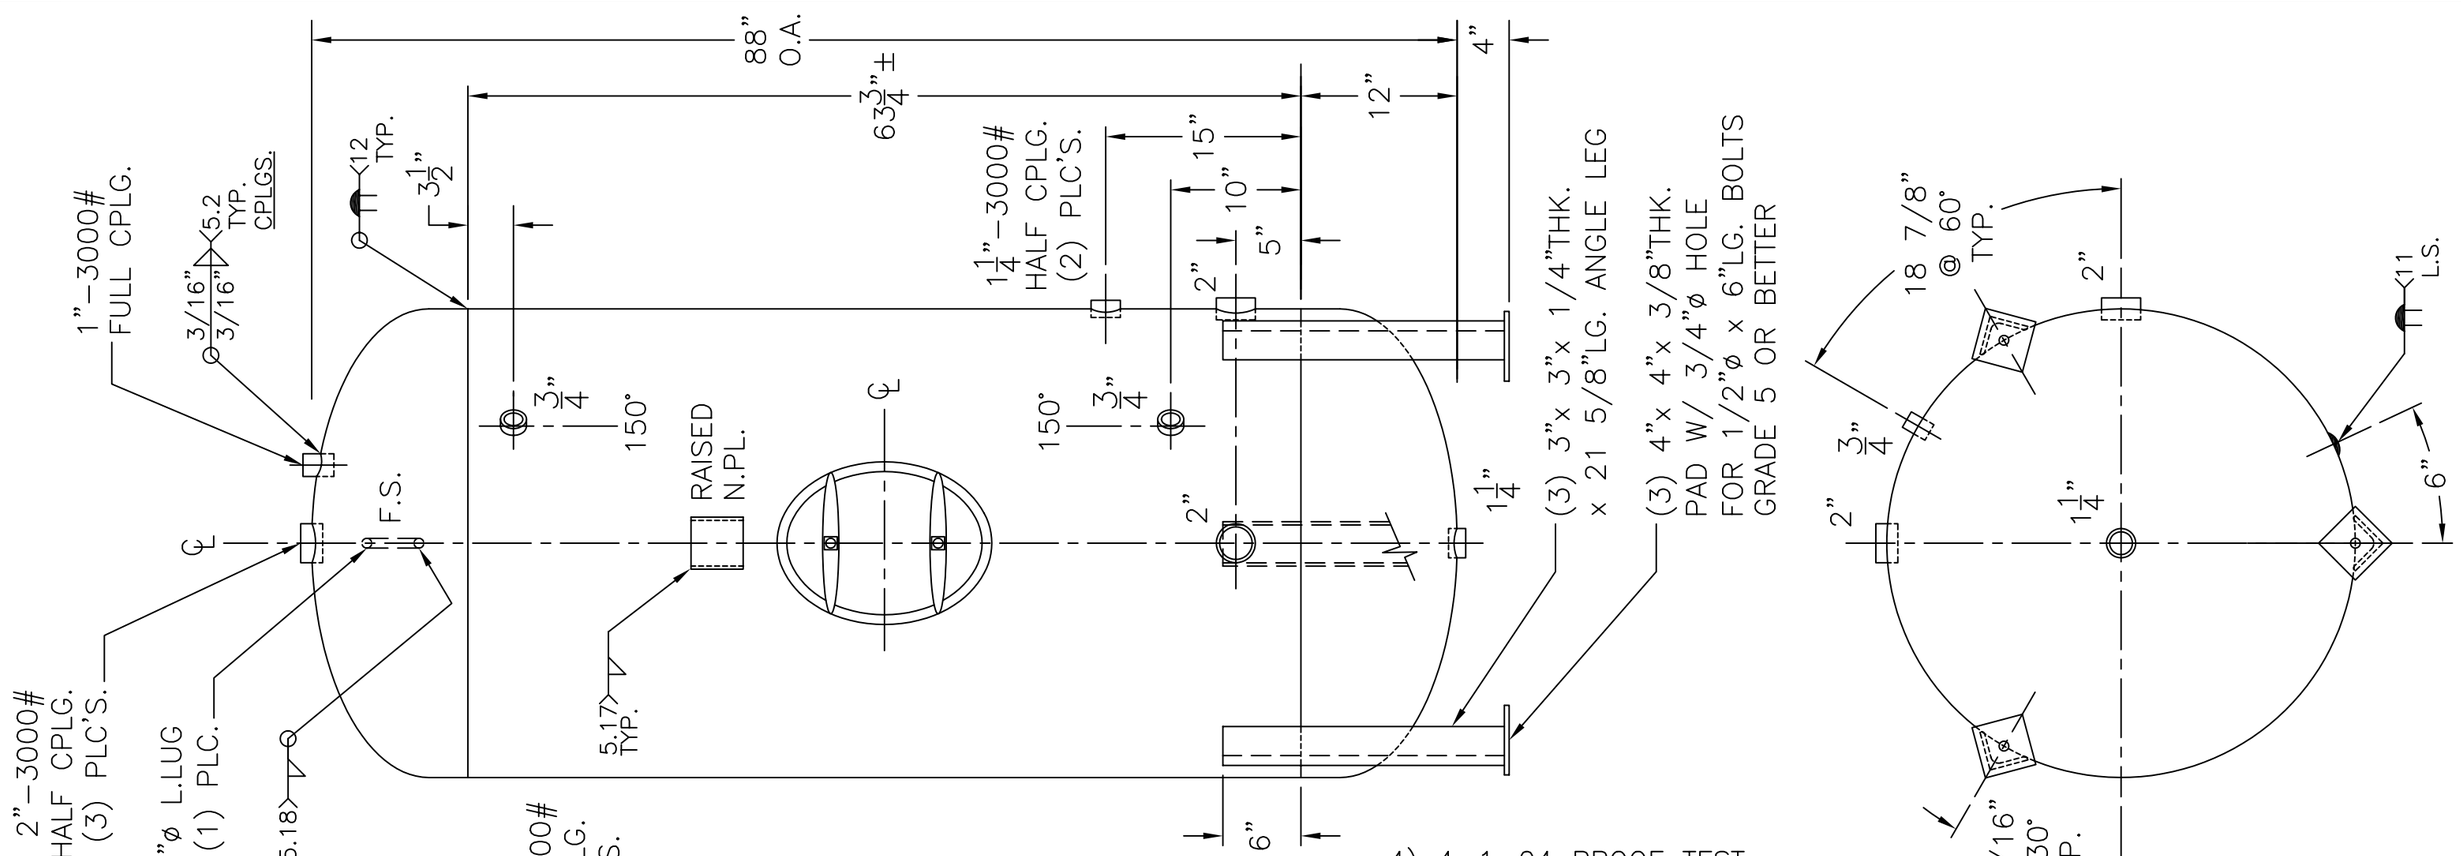

4) 4–1–04 PROOF TEST.
3) HYDRO @ 240 PSIG. MIN.
2) EXTEND ALL CPLGS. 5/8" INSIDE.
NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.182" SA–455 2:1 S.E.
	JOGGLE – .149 OFFSET
	.164" SA–414–G
M.A.W.P. 160 PSIG. @ 210 °F	
ASME. SECTION IV 2004 ADD 2006	
X–RAY: RT–NO / H.L.W.	
GALLONS: 360	WT. 1145 LBS.
SERIAL NO.	
N.B.	

CS–36–360–V	REV. 1–17–07
	DATE: 3–26–03
FOR: HANSON STANDARD	
VERT. HOT WATER TANK	
73.8 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
INSIDE: CEMENT LINED	
OUTSIDE: PRIME	
(334) LEG–ZONE 4–15 KM.	
CAD–"B" UNDER "STD"–SERIES	
BY: E.S.	SCALE: 1"=12"

ROY E. HANSON JR. MFG.
1600 E. WASHINGTON BLVD.
LOS ANGELES, CA 90021